



International Journal for Innovative Engineering and Management Research

A Peer Reviewed Open Access International Journal

www.ijiemr.org

COPY RIGHT

2017 IJIEMR. Personal use of this material is permitted. Permission from IJIEMR must be obtained for all other uses, in any current or future media, including reprinting/republishing this material for advertising or promotional purposes, creating new collective works, for resale or redistribution to servers or lists, or reuse of any copyrighted component of this work in other works. No Reprint should be done to this paper, all copy right is authenticated to Paper Authors

IJIEMR Transactions, online available on 31st Oct 2017. Link

[:http://www.ijiemr.org/downloads.php?vol=Volume-6&issue=ISSUE-9](http://www.ijiemr.org/downloads.php?vol=Volume-6&issue=ISSUE-9)

Title: **HYBRID PV-WIND-BATTERY BASED SYSTEM FOR HOUSEHOLD APPLICATIONS USING DC-DC CONVERTER**

Volume 06, Issue 09, Pages: 339 – 350.

Paper Authors

PAGADALA VEERA RAJASEKHAR,C.TARNATH REDDY, M.A.NABI

SVR Engineering College



USE THIS BARCODE TO ACCESS YOUR ONLINE PAPER

To Secure Your Paper As Per **UGC Guidelines** We Are Providing A Electronic Bar Code

HYBRID PV-WIND-BATTERY BASED SYSTEM FOR HOUSEHOLD APPLICATIONS USING DC-DC CONVERTER

Abstract:

In this venture, a control methodology for control stream administration of a network associated half and half PV-wind-battery based framework with a productive multi-input transformer coupled bidirectional dc-dc converter is displayed. The proposed framework expects to fulfill the heap request, deal with the power spill out of various sources, infuse surplus power into the matrix and charge the battery from lattice as and when required. A transformer coupled lift half-connect converter is utilized to bridle control from wind, while bidirectional buck-boost converter is utilized to tackle control from PV alongside battery charging/releasing control. A solitary stage full-connect bidirectional converter is utilized for encouraging air conditioning burdens and communication with framework. The proposed converter engineering has decreased number of energy transformation stages with less part check, and diminished misfortunes contrasted with existing lattice associated half and half frameworks. This enhances the productivity and dependability of the system.

Keywords— Remote Area operations, hybrid system, solar photovoltaic, wind energy Green Energy, Environment friendly, No emission, cost wise Cheap, less maintenance, fast developed renewable energy resources, battery charge control, maximum power point tracking, bi directional DC-DC converter.

Introduction

In a mixture PV-twist framework alongside a battery is introduced, in which the two sources are associated with a typical dc-transport through individual power converters. Furthermore, the dc-transport is associated with the utility lattice through an inverter. The utilization of multi-input converter (MIC) for mixture control frameworks is pulling in expanding consideration in view of diminished part check, upgraded control thickness, smallness and incorporated control. Because of these focal points, numerous topologies are proposed and they can be characterized into three gatherings, non-disconnected, completely separated and in part disengaged multi-port topologies. All the power ports in non-disconnected multi-port topologies share a shared view. To determine the multi-port dc-dc converters, an arrangement or parallel design is utilized in the information side. A few segments can be shared by each info port. A tri-modular half-connect topology is proposed. This topology is basically an altered rendition of the half-connect topology with a free-wheeling circuit branch comprising of a diode and a switch over the essential twisting of the transformer. All the best in class on converter topologies displayed so far can oblige just a single sustainable source and one vitality stockpiling component. Though, the proposed topology is fit for interfacing two inexhaustible sources and a vitality stockpiling component. Consequently, it is more dependable as two unique sorts of sustainable sources like PV and wind are utilized either independently or all the while without increment in the part check contrasted with the current best in class topologies. The proposed framework has two inexhaustible power sources, load, matrix and battery. Subsequently, a power stream administration framework is fundamental to adjust the power stream among every one of these sources. The primary destinations of this framework are as per the following:

- To investigate a multi-target control plot for ideal charging of the battery utilizing numerous sources.
- Supplying un-interruptible energy to loads.
- Ensuring departure of surplus power from sustainable sources to the framework, and charging the battery from lattice as and when required.

The lattice associated cross breed PV-wind-battery based framework for family unit applications, which can work either in remain solitary or matrix associated mode. This framework is appropriate for family applications, where a minimal effort, straightforward and conservative topology equipped for independent operation is alluring. The center of the proposed framework is the multi-input transformer coupled bidirectional dc-dc converter that interconnects different power sources and the capacity component. Further, a control conspire for compelling force stream administration to give continuous power supply to the heaps, while infusing overabundance control into the network is proposed. In this way, the proposed setup and control plot give a rich coordination of PV and wind vitality source. The proposed converter comprises of a transformer coupled lift double half-connect bidirectional converter combined with bidirectional buck-support converter and a solitary stage full-connect inverter. The proposed

converter has lessened number of energy change stages with less segment tally and high proficiency contrasted with the current framework associated schemes.

1.LITERATURE SURVEY 1. DYNAMIC MODELLING AND OPERATION STRATEGY FOR A MICRO GRID WITH WIND AND PHOTOVOLTAIC RESOURCES:

This project presents a dynamic modeling and control strategy for a sustainable micro grid primarily powered by wind and solar energy. A current-source-interface multiple-input dc-dc converter is used to integrate the renewable energy sources to the main dc bus. Potential suitable applications range from a communication site or a residential area. This project presented the dynamic modeling and operational strategy of a sustainable micro grid primarily powered by wind and solar energy. These renewable sources are integrated into the main dc bus through an MI CSI dc-dc converter. Wind energy variations and rapidly changing solar irradiance were considered in order to explore the effect of such environmental variations to the intended micro grid. In addition, the proposed micro grid is equipped with an ESS and is connected with the distribution grid. These diverse micro-energy resources can improve the micro grid performance and reduce power generation variability and vulnerability to natural disasters. Its power converter can also be designed in a smaller size with low production costs because MICs can remove unnecessary redundant components. this paper focused on the MPP tracking of the renewable micro-energy source power variations under the local ac demand changes and the variable dispatch power to the distribution grid. For the wind generator, this project used a variable speed control method whose strategy is to capture the maximum wind energy below the rated wind speed. Specifically, an input current control method was used for this variable speed control. In addition, a circuit-based PV system model with an incremental conductance control method was used for the simulation study. In contrast to previous works, this paper explored the system wide performance of the sustainable micro grid with an MI dc-dc converter when the micro-energy source power, the local ac load, and the dispatch power to the distribution grid change.

2. GRID-CONNECTED THREE-INPUT PV/FC/BATTERY POWER SYSTEM WITH ACTIVE POWER FILTER CAPABILITY:

This project develops a grid connected hybrid PV/FC/Battery power system proposed by authors. This system integrates photovoltaic (PV) array, fuel cell (FC) stack and battery as input power sources in a unified structure by means of a new three-input DC-DC boost converter which supplies a grid connected inverter. In this structure, each switching cycle of the proposed boost converter is divided into five switching periods in comparison with the conventional structure. These switching periods introduce five different duty ratios for the proposed boost converter. Because the summation of these duty ratios should be equaled to one in the prior paper, achieving a high-level output voltage at the DC-link is not possible. Therefore, this paper tries to presents some modifications in order to cancel this limitation of the duty ratios and control them independently. Consequently, a high-level output voltage is achieved in addition to tracking the maximum power of the PV source, setting the power of FC source, and charging or discharging the battery. Utilizing a unified structure and improving the control strategy of the proposed three-input DC-DC converter facilitate power management of the input sources in

order to supply a grid connected residential load. All the system possible power operation modes are defined and managed by the power management control scheme. The proposed system is also able to compensate both reactive and harmonic current components drawn by nonlinear loads as active filter functionality. The proposed control system facilitates power management of HDGS and accessing higher voltage levels because of independently control of the duty ratios. In addition, the system simultaneously is able to inject the generated harmonic currents and correct the power factor of a nonlinear domestic load. The active filtering capability does not require modifications to the power stage. Low harmonics content, simple and unified power electronic circuit, reliable control system, high efficiency and appropriate power management are the advantages of the proposed system.

3. MODELLING AND CONTROLLER DESIGN FOR THE MULTI-INPUT PV/WIND CHARGER:

The objective of this project is to propose a multi-input converter (MIC) for hybrid PV/wind power charger application which can simplify the power system, reduce the cost and deliver continuous power with higher reliability to the load. The proposed MIC consists of a forward-type pulsating voltage source cell (PVSC) and a buck-boost prime converter can realize the maximum power point tracking (MPPT) function for each PV/wind source. Moreover, due to the isolated configuration, the MIC can adopt PV/wind power sources with larger operation voltage difference. In this paper, the small-signal ac model is derived and the controller design is developed. Computer simulations and experimental results are presented to verify the accuracy of the proposed small signal ac model and the performance of the proposed MIC. This project is proposed a MIC for the hybrid PV wind power charger system which can simplify the power system, reduce the cost, deliver continuous power with higher reliability and overcome high voltage-transfer-ratio problems. The operation principle of the proposed MIC is introduced and the small signal ac model is developed. Computer simulations and prototype hardware circuit experimental results are presented to verify the accuracy of the proposed small signal model and the performance of controller for the proposed MIC for hybrid PV/wind battery charger system.

4. MULTI-INPUT TRANSFORMER COUPLED DC-DC CONVERTER FOR PV-WIND BASED STAND-ALONE SINGLE-PHASE POWER GENERATING SYSTEM:

Hybrid PV-wind based stand-alone systems have evolved as a promising solution for rural deployment where access to electrification is not viable. The conventional approach for the integration of multiple renewable sources and energy storage elements involves using dedicated single-input converters for each source and requires more number of converter stages leading to considerable reduction in reliability and efficiency of the system. In order to address this issue, a novel transformer coupled dual-source dc-dc converter followed by a conventional full bridge inverter is proposed. Transformer coupled half-bridge boost converter is used for harnessing power from wind, while bidirectional converter is used for harnessing power from PV along with battery charging/discharging control and a single phase inverter for feeding ac loads. The proposed converter architecture has reduced number of power conversion stages, less component

count and losses as compared to the existing stand-alone schemes. These features improve the efficiency and reliability of the scheme.

A hybrid solar PV-wind based stand-alone power evacuation scheme for rural household application is proposed. It is realized by a novel multi-input transformer coupled dc-dc converter followed by a conventional full bridge dc-ac inverter. The input of the transformer coupled half bridge boost converter is formed by connecting the PV array in series with the battery, which is connected across the capacitor bank C1-C2 thereby incorporating an inherent boosting stage for the scheme. The boosting capability is further enhanced by a high frequency step-up transformer. Bidirectional converter is used for harnessing power from PV along with battery charging/discharging control. The unique feature of this converter is that MPP tracking of PV array, battery charging control and voltage boosting are accomplished through a single converter. Transformer coupled half bridge boost converter is used for harnessing power from wind and a single-phase inverter for feeding ac loads. High boost of PV and wind voltages, battery charging control, required dc-link voltage and galvanic isolation of the load from the sources and the battery are realized only with four controllable switches in the proposed converter configuration. This leads to an improvement in efficiency and reliability of the system. The proposed controller can operate in different modes of a standalone scheme and ensures proper operating mode selection and smooth transition between different possible operating modes.

6. NOVEL INTEGRATION OF PV-WIND ENERGY SYSTEM WITH ENHANCED EFFICIENCY:

An integration scheme of solar PV with a large capacity doubly excited induction generator based wind energy system is described. Both the grid and rotor side power converters of DFIG to inject PV power into the grid. Thus, it renders a cost effective solution to PV-grid integration by obviating the need for a dedicated converter for PV power processing. The system is able to feed significantly large PV power into the grid compared to an equivalent rating inverter used in the conventional PV-grid system. Proposed scheme prevents circulating power during sub-synchronous operation during the All these features enhance system efficiency. The intermittent but complementary nature of solar PV and wind energy sources considerably improves the converters' utilization. Comprehensive system model is presented and used for designing the control strategy.

Nature has provided ample opportunities to mankind to make best use of its resources and still maintain its beauty. In this context, the proposed hybrid PV-wind system provides an elegant integration of the wind turbine and solar PV to extract optimum energy from the two sources. It yields a compact converter system, while incurring reduced cost. The PV generated power can be routed to the grid using both the rotor and grid side converters of the wind-DFIG system, during its sub-synchronous operation. It has been verified that unlike the conventional wind-DFIG system, the circulating power is significantly reduced with PV-DFIG integration at the DC link. Enhanced efficiency is observed compared to existing PV/wind hybrid systems. It is demonstrated that the proposed hybrid system provides an opportunity to integrate a higher capacity PV source than can be done through a dedicated converter as in a conventional solar PV system. Simulations and experimental results have shown that the proposed system optimally uses the daily available energy from solar and wind sources making the best possible utilization of its converters. Due to limited laboratory resources, a small, low power prototype has been

used for validation. It is expected that some advantages of the proposed scheme (e.g. high converter utilization, reduction in circulating power, enhanced stability due to turbine inertia etc.) will be more pronounced for high power PV-wind farm systems. There is also a scope of designing the DFIG-wind turbine more optimally for the hybrid solution presented. The proposed hybrid combination can also render a neat stand-alone energy solution with minimum storage and can, in fact, be developed as a dispatch able source. Overall, the proposed system makes good use of the nature's complementary behavior for wind velocity and solar radiation. Sometimes this complementary trend may break down, in which case the proposed control scheme is well equipped to prevent converters' overloading at the cost of momentary loss of PV power. Such instances, however, are expected to be rare.

7. STANDALONE HYBRID WIND-SOLAR POWER GENERATION SYSTEM APPLYING DUMP POWER CONTROL WITHOUT DUMP LOAD:

This project proposes a unique standalone hybrid power generation system, applying advanced power control techniques, fed by four power sources: wind power, solar power, storage battery, and diesel engine generator, and which is not connected to a commercial power system. Considerable effort was put into the development of active-reactive power and dump power controls. The result of laboratory experiments revealed that amplitudes and phases of ac output voltage were well regulated in the hybrid system. Different power sources can be interconnected anywhere on the same power line, leading to flexible system expansion. It is anticipated that this hybrid power generation system, into which natural energy is incorporated, will contribute to global environmental protection on isolated islands and in rural locations without any dependence on commercial power systems. The authors have proposed a unique standalone hybrid wind solar power generation system, which is characterized by PLL control and dump power control. In particular, dump power control allows for formation of a feedback loop in this system, meaning that there is no requirement for a dedicated high-speed line to transmit storage battery voltage and current data. In case the power line is used as a media for data transmission, the line voltage amplitudes can be applied as a means of data transmission; thus, there is no requirement for installation of any optical fiber transmission line or power line carrier system through which harmonic signals are applied to power line. In addition, neither dump load nor dump load control device are necessary. Under our dump power control, regulation of output is done without battery overcharging, and effective use of surplus power is made possible. This contributes to battery life extension and realization of a low-cost system. The system, through ac system interconnection, will also allow flexible system expansion in the future. Further, power sources including EG can be flexibly interconnected anywhere through the same power line, and power quality stability can be maintained by controlling the phase and amplitude of ac output voltage. It is expected that this hybrid system into which natural energy is incorporated, and which makes use of various power control techniques, will be applicable in rural locations, even those with poor communications media. The system will also contribute to global environmental protection through application on isolated islands without any dependence on commercial power systems.

8. SUPERVISORY CONTROL OF STANDALONE WIND / SOLAR ENERGY GENERATION SYSTEMS:

The use of renewable energy technology to meet the energy demands has been increasing for the past few years. However, the important drawbacks associated with renewable energy systems are their inability to guarantee reliability and their intermittent nature. At present, standalone solar photovoltaic energy system cannot provide reliable power during night time or non-sunny days. The standalone wind system cannot satisfy constant load demands due to fluctuations in the magnitude of wind speeds from hour to hour throughout the year. This work focuses on the development of a supervisory model predictive control method for the optimal management and operation of hybrid standalone wind-solar energy generation systems. The proposed method is to design the supervisory control system via model predictive control which computes the power references for the wind and solar subsystems. The power references are sent to two local controllers which drive the two subsystems to the requested power references. The system is modeled in MATLAB SIMULINK and simulation results show that maximum power generated from hybrid system at varying environmental conditions. This thesis focused on the development of a supervisory predictive control method for the optimal management and operation of hybrid wind-solar energy generation systems. This project proposed a supervisory control system designed via MPC which computes the power references for the wind and solar subsystems at each sampling time while minimizing a suitable cost function. The power references are sent to two local controllers which drive the two subsystems to the power references. The controllers are designed to get maximum power form wind results demonstrated the effectiveness and applicability of the proposed approach.

9. SUPERVISORY PREDICTIVE CONTROL OF STANDALONE WIND/SOLAR ENERGY GENERATION SYSTEMS:

This work focuses on the development of a supervisory model predictive control method for the optimal management and operation of hybrid standalone wind-solar energy generation systems. We design the supervisory control system via model predictive control which computes the power references for the wind and solar subsystems at each sampling time while minimizing a suitable cost function. The power references are sent to two local controllers which drive the two subsystems to the requested power references. We discuss how to incorporate practical considerations, for example, how to extend the life time of the equipment by reducing the peak values of inrush or surge currents, into the formulation of the model predictive control optimization problem. In this work, we focused on the development of a supervisory predictive control method for the optimal management and operation of hybrid wind-solar energy generation systems. We proposed a supervisory control system designed via MPC which computes the power references for the wind and solar systems at each sampling time while minimizing a suitable cost function. The power references are sent to two local controllers which drive the two subsystems to the power references. We discussed how to incorporate practical considerations, for example, howto reduce the peak values of inrush or surge currents, into the formulation of the MPC optimization problem. Simulation results demonstrated the effectiveness and applicability of the proposed approach. Future work will include the investigation of large

time span behavior of the hybrid wind-solar generation system taking into account information of future weather forecast, and investigation of the performance of the system under the condition that the future power demand is unknown.[9]

3. Comparative Analysis

From above surveyed papers, all the Solar PV panels are connected to Grid and Battery bank only. A micro grid nowadays plays a very vital role in all these systems. In this project, Extract maximum energy from elegant integration of PV and wind sources with multi input transformer coupled bidirectional DC-DC converter with versatile control and better utilisation without affecting life of battery and better power flow management.

4. Proposed System

The proposed converter consists of a transformer coupled boost dual-half-bridge bidirectional converter fused with bidirectional buck-boost converter and a single-phase full-bridge inverter is shown in (fig-1). The proposed converter has reduced number of power conversion stages with less component count and high efficiency compared to the existing grid-connected schemes. The topology is simple and needs only six power switches. The boost dual-half-bridge converter has two dc-links on both sides of the high frequency transformer. Controlling the voltage of one of the dc-links ensures controlling the voltage of the other. This makes the control strategy simple. Moreover, additional converters can be integrated with any one of the two dc-links. A bidirectional buck-boost dc-dc converter is integrated with the primary side dc-link and single-phase full-bridge bidirectional converter is connected to the dc-link of the secondary side. The grid-connected hybrid PV-wind-battery based system for household applications, which can work either in stand-alone or grid connected mode. This system is suitable for household applications, where a low-cost, simple and compact topology capable of autonomous operation is desirable. The core of the proposed system is the multi-input transformer coupled bidirectional dc-dc converter that interconnects various power sources and the storage element.

Advantages:

- Less component count and reduced losses.
- Reduced number of power conversion stages.
- Inject surplus power into the grid and charge the battery from grid as and when required.

Applications:

1. Household Application.
2. Grid-connected hybrid PV-wind-battery system.
3. Standalone hybrid PV-wind-battery system.

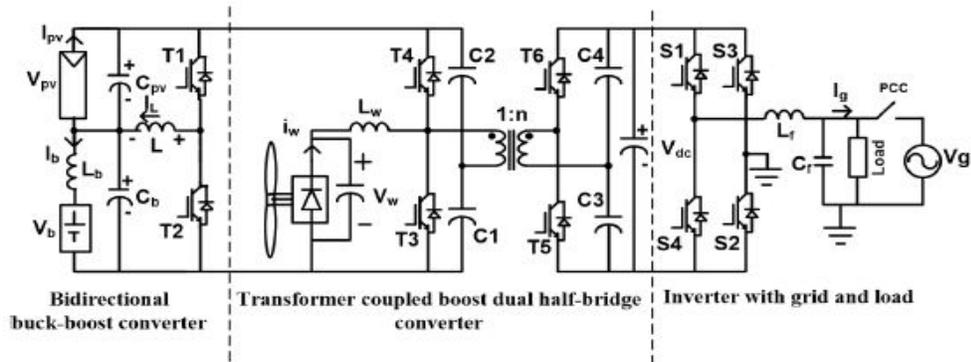


Fig 1. Circuit Diagram of Proposed system

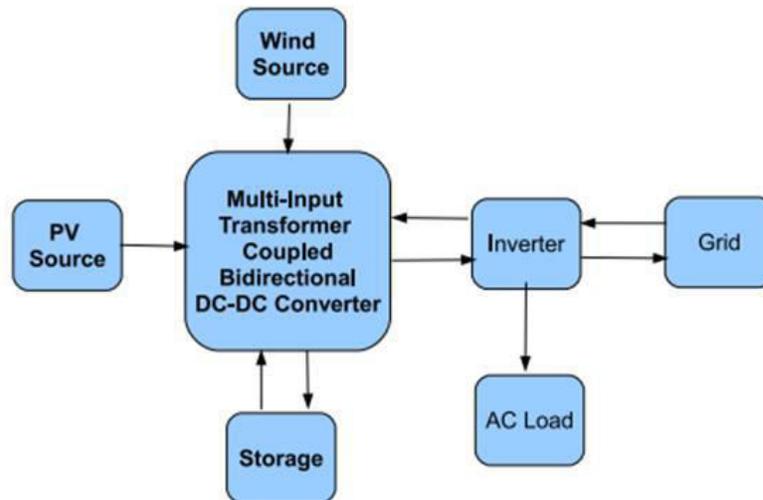
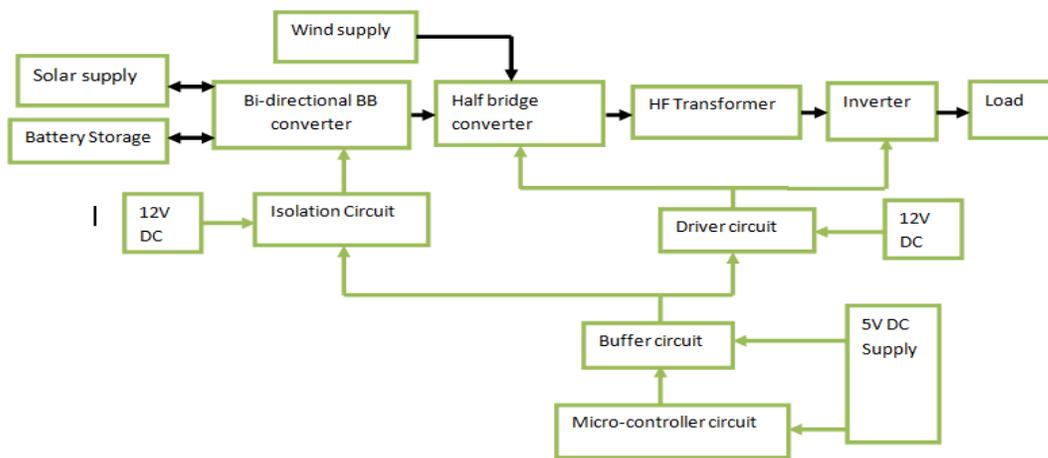


Fig 2. Block diagrams of proposed system

5. Result and Discussion

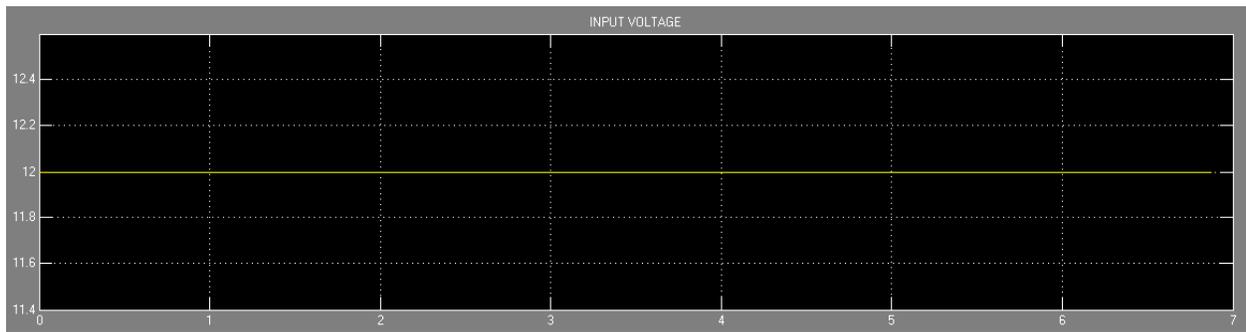


Fig 3.Input Voltage

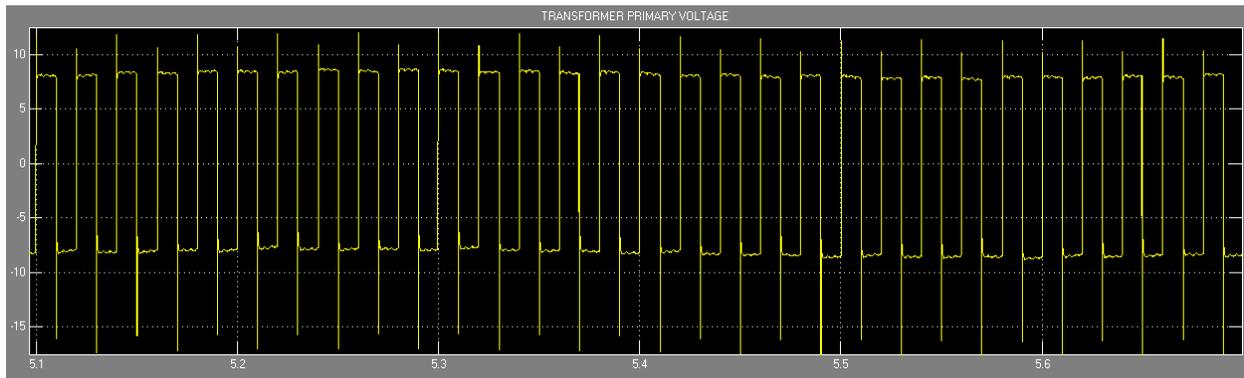


Fig 4.Transformer primary voltage

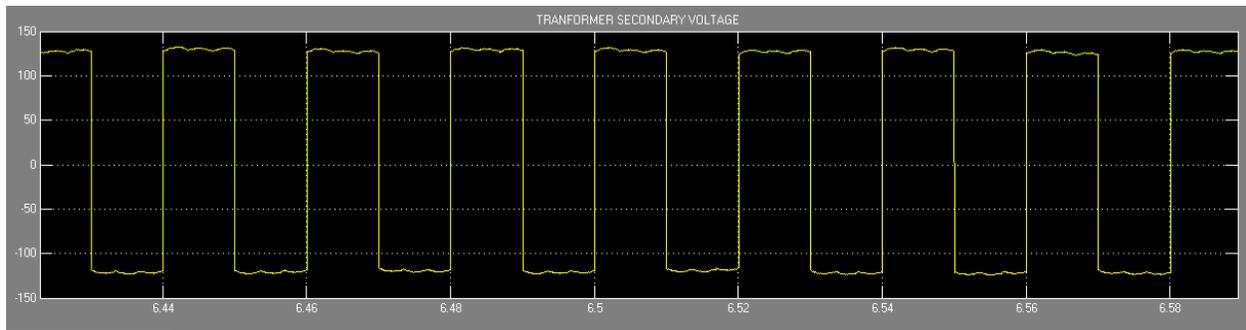


Fig 5.Transformer secondary voltage

Conclusion

A hybrid PV-wind-battery based power evacuation scheme for household application is proposed. The proposed hybrid system provides an elegant integration of PV and wind source to extract maximum energy from the two sources. It is realized by a novel multi-input transformer coupled bidirectional dc-dc converter followed by a conventional full-bridge inverter. A versatile control strategy which achieves better utilization of PV, wind power, battery capacities without effecting life of battery and power flow management in a grid-connected hybrid PV-wind-battery based system feeding ac loads is presented. Detailed simulation studies are carried out to ascertain the viability of the scheme. The experimental results obtained are in close agreement with simulations and are supportive in demonstrating the capability of the system to operate either in grid feeding or stand-alone mode. The proposed configuration is capable of supplying un-interruptible power to ac loads, and ensures evacuation of surplus PV and wind power into the grid.

REFERENCES

- [1] F. Valenciaga and P. F. Puleston, "Supervisor control for a stand-alone hybrid generation system using wind and photovoltaic energy," *IEEE Trans. Energy Convers.*, vol. 20, no. 2, pp. 398-405, Jun. 2005.
- [2] C. Liu, K. T. Chau and X. Zhang, "An efficient wind-photovoltaic hybrid generation system using doubly excited permanent-magnet brushless machine," *IEEE Trans. Ind. Electron.*, vol. 57, no. 3, pp. 831-839, Mar. 2010.
- [3] W. Qi, J. Liu, X. Chen, and P. D. Christofides, "Supervisory predictive control of standalone wind/solar energy generation systems," *IEEE Trans. Control Sys. Tech.*, vol. 19, no. 1, pp. 199-207, Jan. 2011.
- [4] F. Giraud and Z. M. Salameh, "Steady-state performance of a gridconnected rooftop hybrid wind-photovoltaic power system with battery storage," *IEEE Trans. Energy Convers.*, vol. 16, no. 1, pp. 1-7, Mar. 2001.
- [5] S. K. Kim, J. H. Jeon, C. H. Cho, J. B. Ahn, and S. H. Kwon, "Dynamic modeling and control of a grid-connected hybrid generation system with versatile power transfer," *IEEE Trans. Ind. Electron.*, vol. 55, no. 4, pp. 1677-1688, Apr. 2008.
- [6] M. Dali, J. Belhadj and X. Roboam, "Hybrid solar-wind system with battery storage operating in grid-connected and standalone mode: control and energy management-experimental investigation," *Energy*, vol. 35, no. 6, pp. 2587-2595, June 2010.
- [7] W. Kellogg, M. Nehrir, G. Venkataramanan, and V. Gerez, "Generation unit sizing and cost analysis for stand-alone wind, photovoltaic and hybrid wind/PV systems," *IEEE Trans. Ind. Electron.*, vol. 13, no. 1, pp. 70-75, Mar. 1998.
- [8] L. Xu, X. Ruan, C. Mao, B. Zhang, and Y. Luo, "An improved optimal sizing method for wind-solar-battery hybrid power system," *IEEE Trans. Sustainable Energy*, vol. 4, no. 3, pp. 774785, Jul. 2013.
- [9] B. S. Borowy and Z. M. Salameh, "Dynamic response of a stand-alone wind energy conversion system with battery energy storage to a wind gust," *IEEE Trans. Energy Convers.*, vol. 12, no. 1, pp. 73-78, Mar. 1997.
- [10] S. Bae and A. Kwasinski, "Dynamic modeling and operation strategy for a microgrid with wind and photovoltaic resources," *IEEE Trans. Smart Grid*, vol. 3, no. 4, pp. 1867-1876, Dec. 2012.

- [11] C. W. Chen, C. Y. Liao, K. H. Chen and Y. M. Chen, "Modeling and controller design of a semi isolated multi input converter for a hybrid PV/wind power charger system," *IEEE Trans. Power Electron.*, vol. 30, no. 9, pp. 4843-4853, Sept. 2015.
- [12] M. H. Nehrir, B. J. LaMeres, G. Venkataramanan, V. Gerez, and L. A. Alvarado, "An approach to evaluate the general performance of stand-alone wind/photovoltaic generating systems," *IEEE Trans. Energy Convers.*, vol. 15, no. 4, pp. 433-439, Dec. 2000.
- [13] W. M. Lin, C. M. Hong, and C. H. Chen, "Neural network-based MPPT control of a stand-alone hybrid power generation system," *IEEE Trans. Power Electron.*, vol. 26, no. 12, pp. 3571-3581, Dec. 2011.
- [14] F. Valenciaga, P. F. Puleston, and P. E. Battaiotto, "Power control of a solar/wind generation system without wind measurement: a passivity/sliding mode approach," *IEEE Trans. Energy Convers.*, vol. 18, no. 4, pp. 501-507, Dec. 2003.
- [15] T. Hirose and H. Matsuo, "Standalone hybrid wind-solar power generation system applying dump power control without dump load," *IEEE Trans. Ind. Electron.*, vol. 59, no. 2, pp. 988-997, Feb. 2012.
- [16] S. A. Daniel and N. A. Gounden, "A novel hybrid isolated generating system based on PV fed inverter-assisted wind-driven induction generators," *IEEE Trans. Energy Convers.*, vol. 19, no. 2, pp. 416-422, Jun. 2004.
- [17] R. Wandhare and V. Agarwal, "Novel integration of a PV-wind energy system with enhanced efficiency," *IEEE Trans. Power Electron.*, vol. 30, no. 7, pp. 3638-3649, Jul. 2015.
- [18] Z. Qian, O. A. Rahman, and I. Batarseh, "An integrated four-Port DC/DC converter for renewable energy applications," *IEEE Trans. Power Electron.*, vol. 25, no. 7, pp. 1877-1887, July. 2010.
- [19] F. Nejabatkhah, S. Danyali, S. Hosseini, M. Sabahi, and S. Niapour, "Modeling and control of a new three-input DC-DC boost converter for hybrid PV/FC/battery power system," *IEEE Trans. Power Electron.*, vol. 27, no. 5, pp. 2309-2324, Feb. 2014.
- [20] Y. M. Chen, C. Cheng, and H. Wu, "Grid-connected hybrid PV / wind power generation system with improved DC bus voltage regulation strategy," in *Proc. of Applied Power Electronics Conference and Exposition, (APEC), Texas*, pp.1088-1094, Mar. 2006